


SPLICING ELECTRIC CABLE

-COMPACTED GRANULAR (CA-6) BACKFILL IN AREAS UNDER PAVEMENT COMPACTED SELECTED BACKFILL UNDER TURF AREAS. 6" WARNING TAPE -SAND BACKFILL (ONLY WHEN CONDUIT OR UNIT DUCT IS PLACED IN TRENCH) CONDUIT OR UNIT DUCT 6" to 12"

TRENCH AND BACKFILL

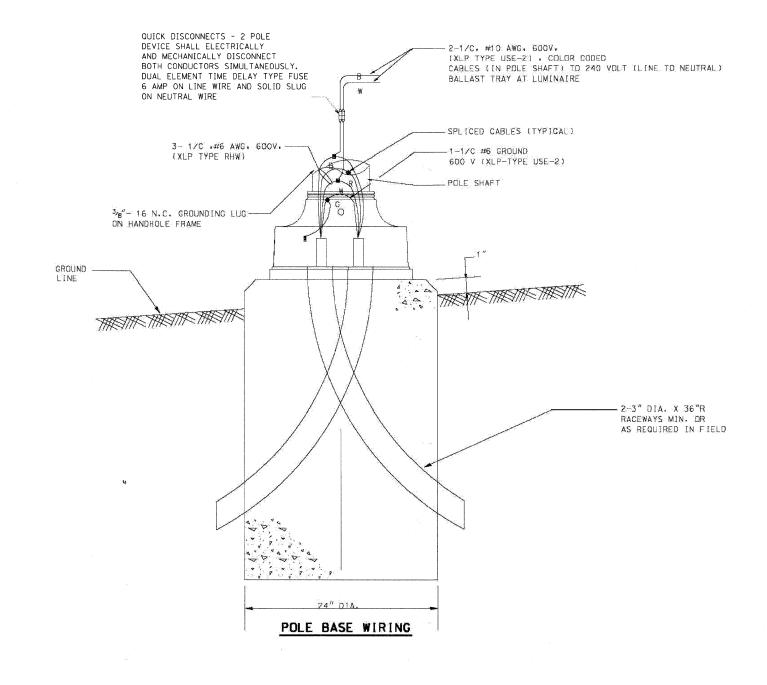

SCALE: NTS SHEET NO. 11 OF 13 SHEETS STA.

VILLAGE OF NILES

COUNTY TOTAL SHEET NO.

COOK 169 84 SECTION **ELECTRICAL DETAILS** 3513 08-00107-01-PV CONTRACT NO. TO STA.